



1250 (2 COMPARTMENT) H2O GREASE TRAP

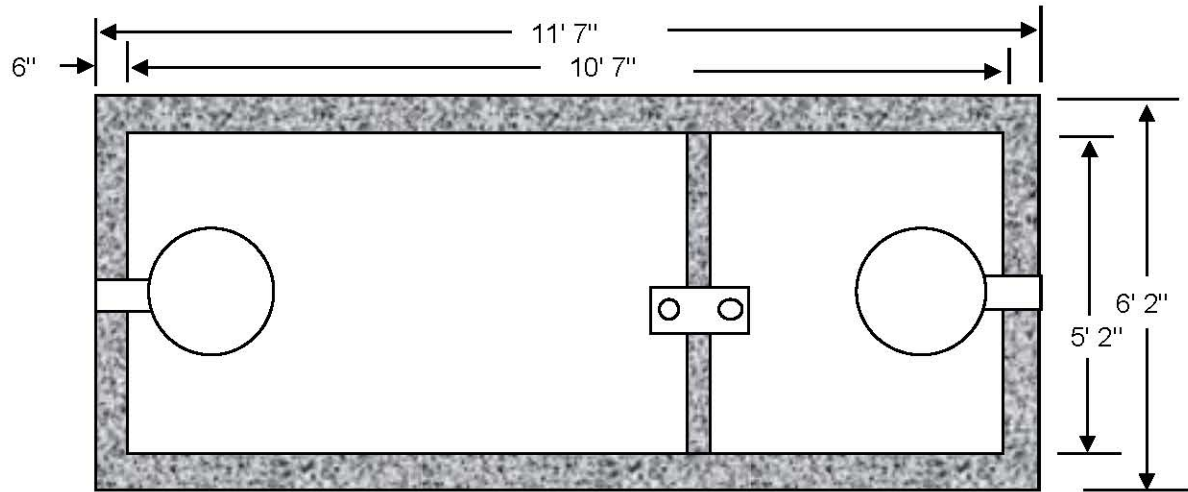

Compartments are 2/3 & 1/3 per NJDEP specifications

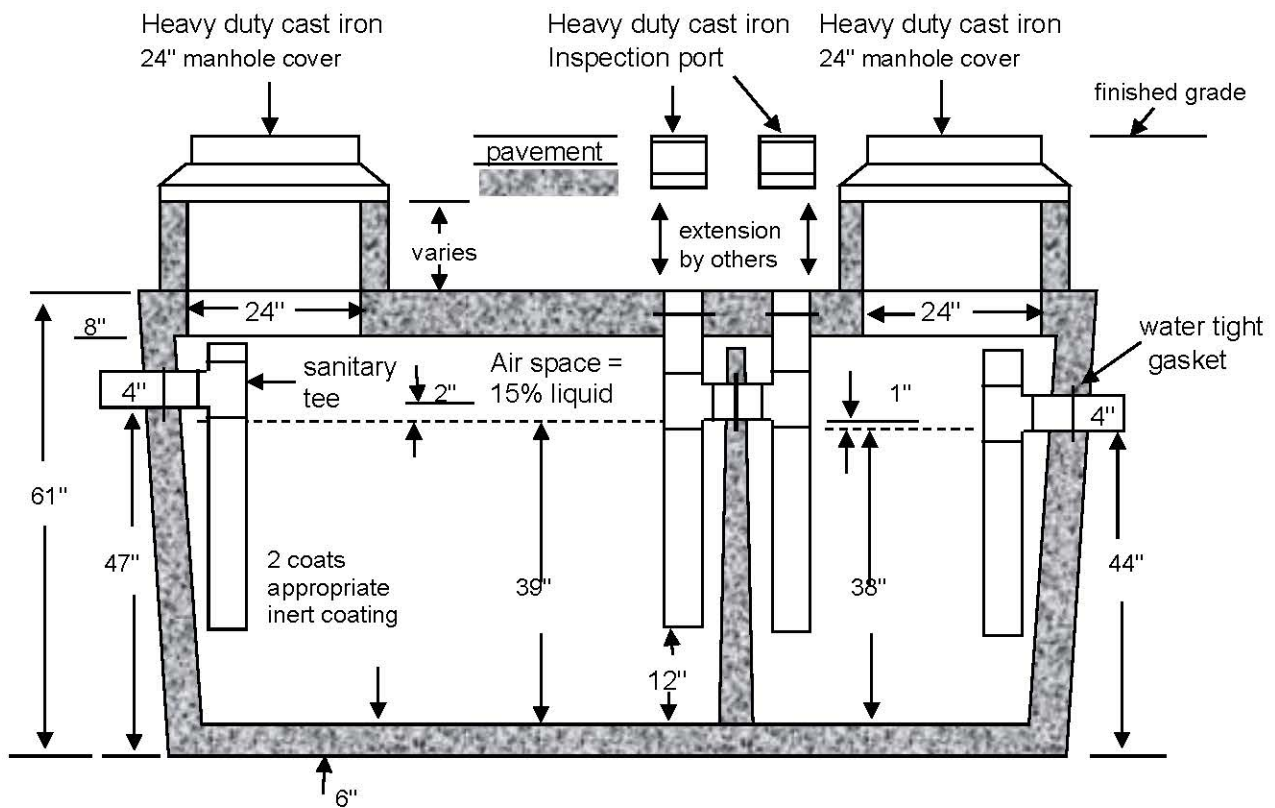

As Manufactured by Mershon Concrete - Bordentown, NJ

Notes:

1. Tank is 4500 psi concrete - steel reinforced
2. H-20 Loading per ASTM A 615-57T
3. Tank complies with all requirements of NJDEP Chapter 199 7:9A-8.2 and NJDEP Chapter 199 7:9A-8.1 E, F, G, H
4. In an effort to continually improve our products, Mershon Concrete reserves the right to change product design without notice.
5. Openings may be cast to suit.
6. All external components are extra.



Rt. 130, PO Box 254
Bordentown, NJ 08505

1-609-298-2150

1-800-MERSHON

1-609-298-7969 / FAX#

1250 (2 compartment)
H2O Grease Trap